


## GENERAL NOTES:

1. DRAWING NOT TO SCALE.
2. ALL FITTINGS AND D.I. PIPE TO BE WRAPPED IN POLYETHYLENE.
3. IN UNSTABLE GROUND THE FIRE HYDRANT SHALL BE RODDED FROM THE TEE TO THE HYDRANT.
4. 5' UNOBSTRUCTED AREA IN FRONT AND ON SIDES WITH A 3' UNOBSTRUCTED AREA BEHIND. AREAS SHALL BE CONSTANTLY MAINTAINED.
5. VALVE NUT SHALL BE AT A DEPTH OPERABLE BY A 6' KEY.
6. THREADS ON HOSE FITTINGS TO BE GREASED.

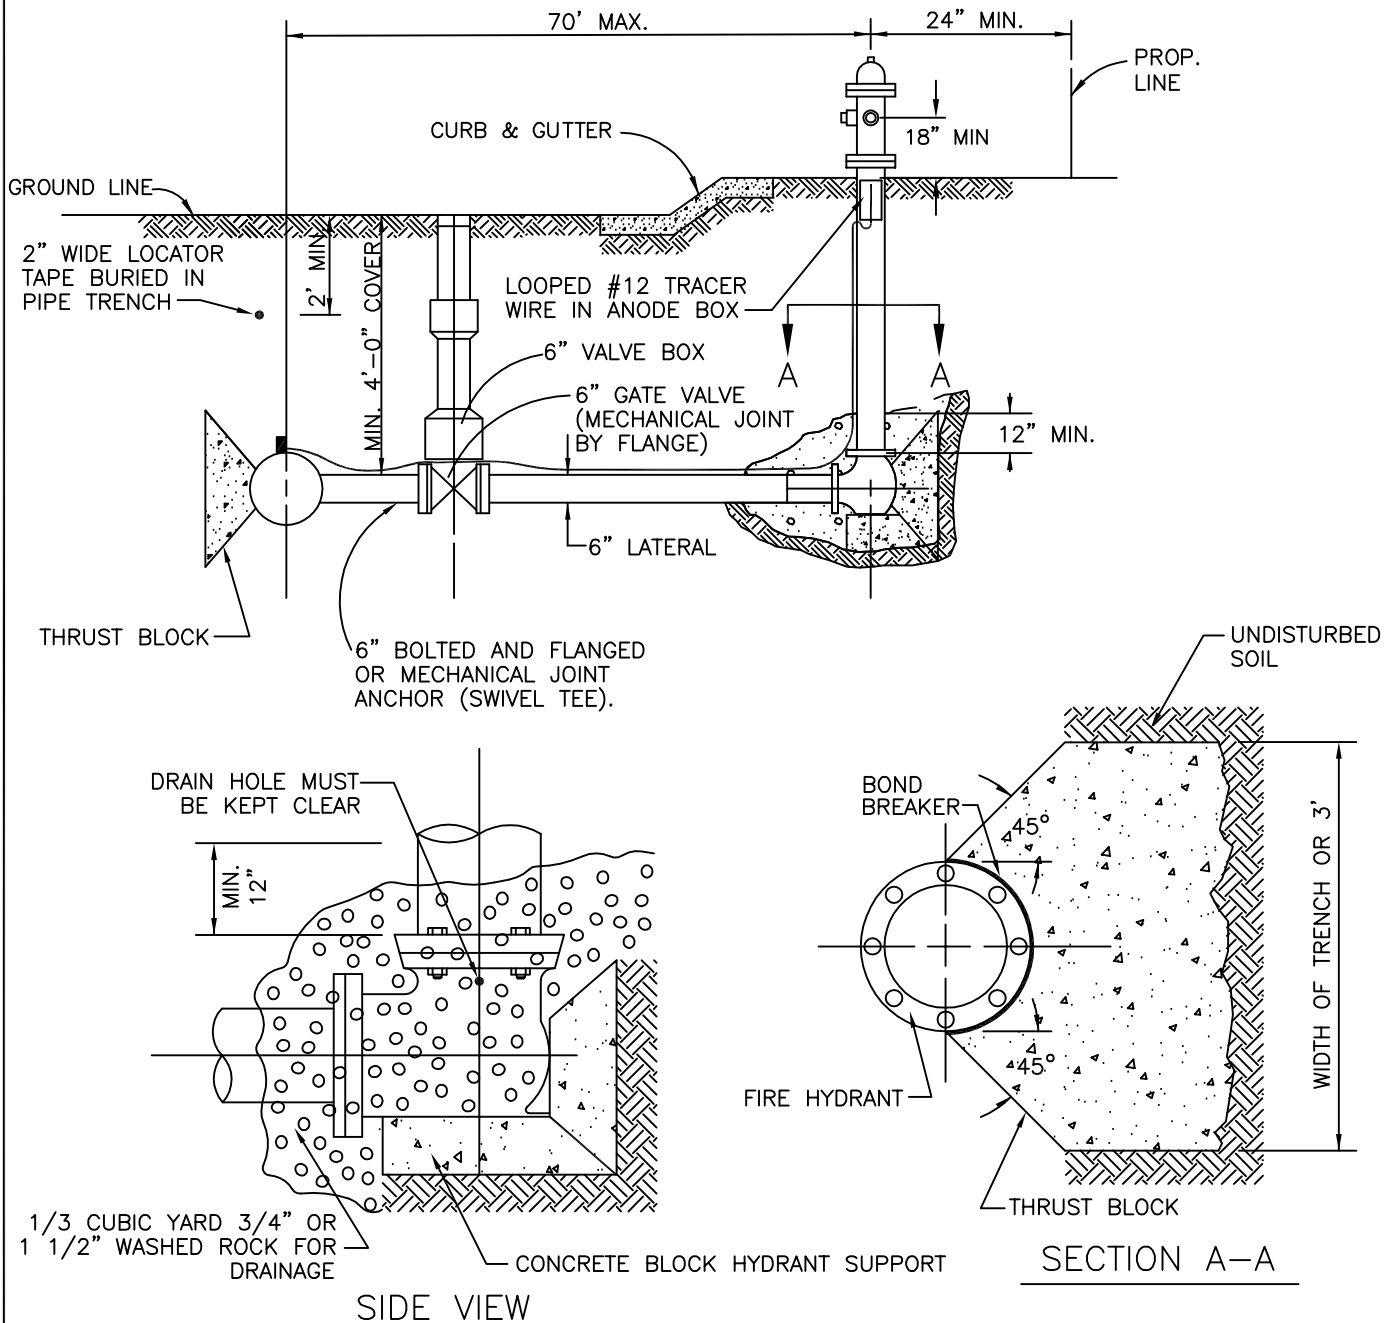

**CITY of DELTA**  
**360 MAIN STREET**  
**DELTA, CO 81416**

## FIRE HYDRANT INSTALLATION DETAIL

DATE: DEC. 1998

SHEET W2 OF 13